

Alltac - Sirius


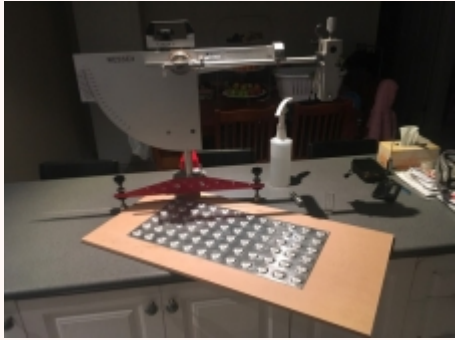
25 Jul 2017




Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested:	25 Jul 2017
Test Report Number:	2507171
Client Name & Address:	Alltac 39/1 Kingston Road Heatherton VIC 3202
Location of Test :	Sliptest Victoria 3 Treboryn Court Rowville VIC 3178
Surface / Product Tested :	Alltac Sirius
Wet Pendulum Test carried out using :	Slider 96 (4S) Rubber slider
Record ambient temperature (°C)	20
Fixed / Unfixed Test :	Yes - Tested in the Direction of Anticipated Pedestrian Traffic
Testing Officer :	Gary Wiltshire
Testing Officer Signature	

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited.

Test Results :

	Mean BPN of last 3 swings :	Image of Surface
Test Location 1	53	
Test Location 2	50	

	Mean BPN of last 3 swings :	Image of Surface
Test Location 3	59	
Test Location 4	57	
Test Location 5	51	

Mean BPN Slip Resistance Value (SRV)	54
Corrected Mean BPN (SRV) Slider 55 ONLY	NA
Using Slider 96 (4S) you have achieved a BPN of	P5 = > 54